

CERTIFICATE OF ANALYSIS

Product Name	FOXO4-DRI, Cat.#: 318716 (TFA removed)
Lot No.	MTFB20519-260202
Sequence	IrlrkepaseiaqsileaysqnGwanrrsGGkrpprrqrrkkrG (Acetate Salt)
Dissolution condition	100%H2O
Modification	Acetate salt; i=D-allo-Ile; lower case letters: D-amino acid
Molecular Weight (MW)	5358.05
Storage	-20°C

Test Items	Specifications	Results
MW by MS	5359.20	Conforms
Purity by HPLC	>95%	95.032%
Endotoxin Content	N/A	N/A
TFA solubility	N/A	N/A
Moisture content	N/A	N/A
Acetic acid content	N/A	N/A
Appearance	White to off-white lyophilized powder	Conforms
Quantity	500mg	5.0mg*100

NovoPro Bioscience Inc. (hereafter NovoPro) warrants material of said quality at the time of sale. It is the sole responsibility of the customers to determine the adequacy of all materials for any intended or specific purpose or use. NovoPro's sole obligation is to replace the material up to the extent of the purchase price. This warranty applies only to products in original packaging and does not apply to a product which has been tampered with or altered in any way in or which has been misused or damaged by accident or negligence. All claims must be received writing (by fax or email) within 30 days from date when product arrive at the destination city and failure to do so shall constitute a waiver by customers for any and all such claims.

Certified by:



Quality Assurance Department

Feb/09/2026




Sample Information


Order ID :MTFB20519
 Name :FOXO4-DRI (TFA removed)
 Sequence :ltlrkepaseiaqsileaysqnGwanrrsGGkrppprqrkkrG (Acetate Salt)
 Lot. No :MTFB20519-260202
 Pump A :0.1%Trifluoroacetic in 100% water
 Pump B :0.1%Trifluoroacetic in 100% acetonitrile
 Total Flow :1ml/min
 Wavelength :214nm
 Analytical column type :Kromasil 100-5-C18 (4.6*250mm*5 μm)
 Dissolution method :100%H2O
 Inj. Volume : 40ul
 Time Module Action Value
 0.01 Pumps B.Conc 20
 30.00 Pumps B.Conc 50
 33.00 Pumps B.Conc 100
 38.00 Pumps B.Conc 100
 40.00 Pumps B.Conc 20
 50.00 Controller Stop

Chromatogram

mV

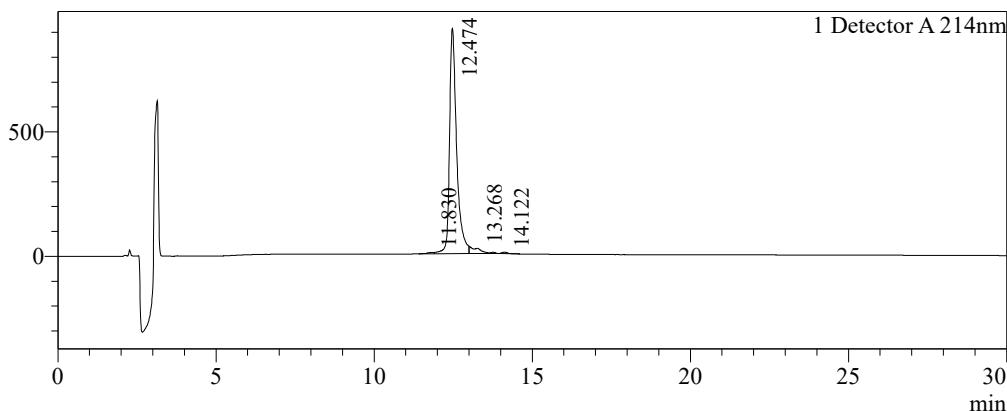
Peak Table
Detector A 214nm

Peak#	Ret. Time	Area	Height	Area%
1	11.830	84370	5597	0.566
2	12.474	14164668	904669	95.032
3	13.268	588809	20803	3.950
4	14.122	67269	5557	0.451
Total		14905117	936626	100.000

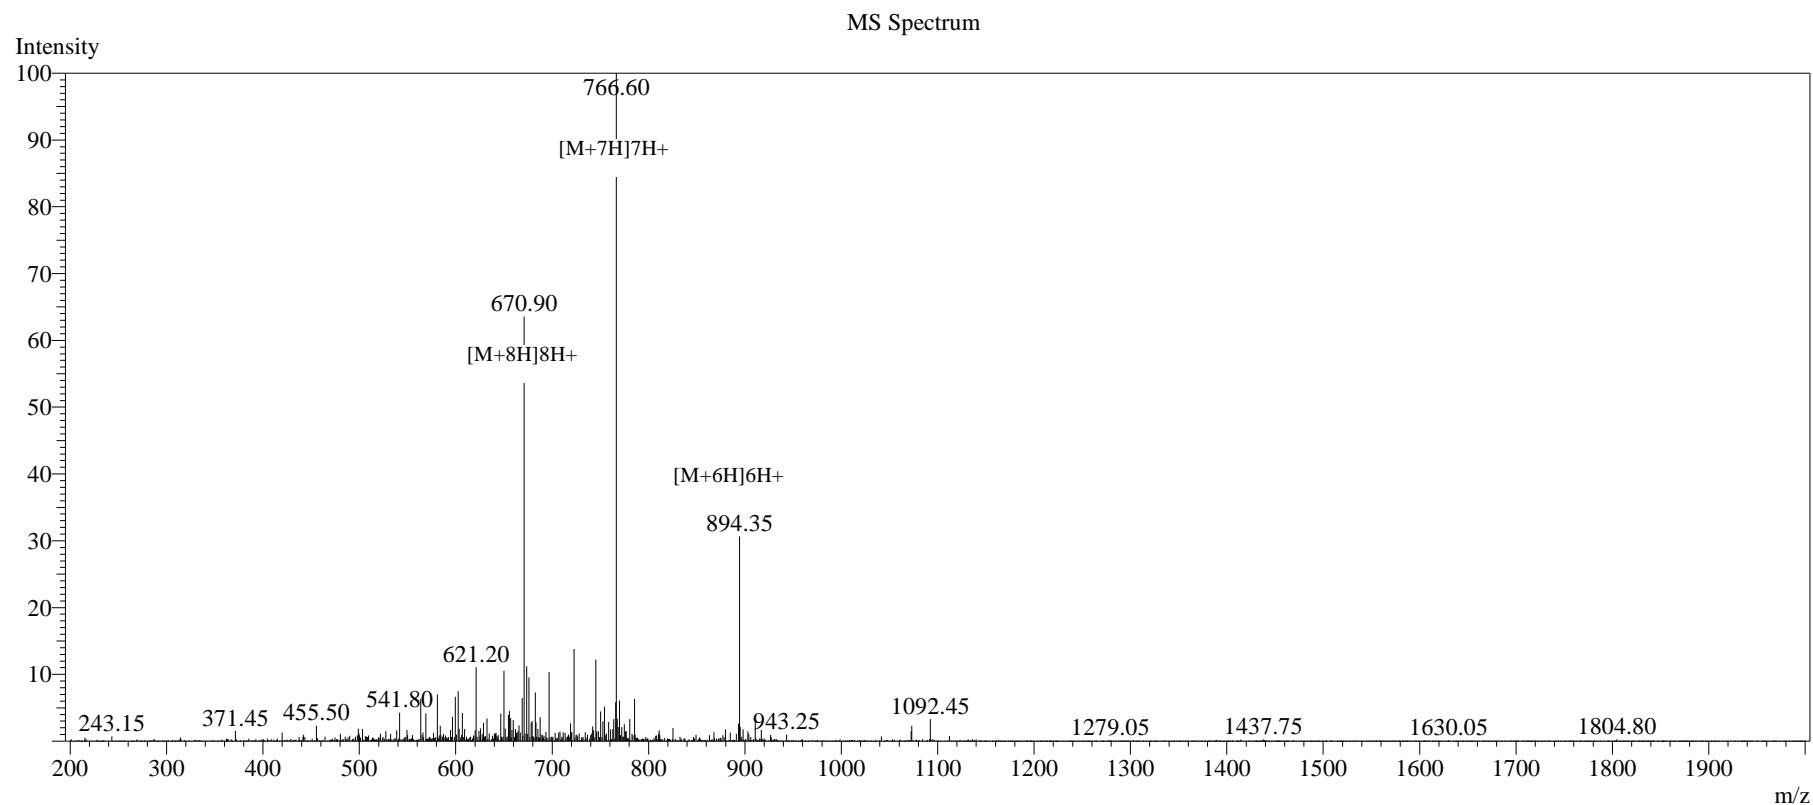

Sample Information

Dissolution method	:15%ACN+85%H2O	Interface	:ESI	Prerod Bias	:+4.5kv
Date Acquired	:2026/02/03 14:49:28	Nebulizing Gas Flow	:1.50L/min	Detector	:-0.2kv
Injection Volume	:0.2ul	CDL Temp	:250°C	T.Flow	:0.2ml/min
Block Temp	:200	CDL Volt	:0v	B.conc	:50%H2O/50%MEOH

Order ID	:MTFB20519
Name	:FOXO4-DRI (TFA removed)
Sequence	:ltlrkepaseiaqsileaysqnGwanrrsGGkrpprrqrkkkrG (Acetate Salt)
Lot.No	:MTFB20519-260202
Theoretical	:5358.05
Observed	:5359.20